



Designation: D4870 – 09



Designation: 375/99

Standard Test Method for Determination of Total Sediment in Residual Fuels¹

This standard is issued under the fixed designation D4870; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope*

1.1 This test method covers the determination of total sediment up to 0.40 % m/m for distillate fuel oils containing residual components and to 0.50 % m/m in residual fuel oils having a maximum viscosity of 55 cSt (mm^2/s) at 100°C. Some fuels can exceed the maximum filtration time specified in this test method due to factors other than the presence of significant quantities of insoluble organic or inorganic material. This test method can be used for the assessment of total sediment after regimes of fuel pretreatment designed to accelerate the aging process.

1.2 The values stated in SI units are to be regarded as standard. No other units of measurement are included in this standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.* For specific warning statements, see 7.2, 7.3, Annex A1, and X1.6.1.

2. Referenced Documents

2.1 *ASTM Standards:*²

D4057 Practice for Manual Sampling of Petroleum and Petroleum Products

D4177 Practice for Automatic Sampling of Petroleum and Petroleum Products

E1 Specification for ASTM Liquid-in-Glass Thermometers

3. Terminology

3.1 *Definitions of Terms Specific to This Standard:*

¹ This test method is under the jurisdiction of ASTM Committee D02 on Petroleum Products and Lubricants and is the direct responsibility of Subcommittee D02.14 on Stability and Cleanliness of Liquid Fuels.

Current edition approved April 15, 2009. Published May 2009. Originally approved in 1988. Last previous edition approved in 2007 as D4870–07a. DOI: 10.1520/D4870-09.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

3.1.1 *total sediment*—the sum of the insoluble organic and inorganic material that is separated from the bulk of the residual fuel oil by filtration through a Whatman GF/A filter medium, and that is also insoluble in a predominantly paraffinic solvent.

4. Summary of Test Method

4.1 A weighed quantity (10 g) of the oil sample is filtered through the prescribed apparatus at 100°C. After solvent washing and drying the total sediment on the filter medium is weighed. The test is to be carried out in duplicate.

5. Significance and Use

5.1 Appreciable amounts of sediment in a residual fuel oil can cause fouling of facilities for handling, and give problems in burner mechanisms. Sediment can accumulate in storage tanks, on filter screens, or on burner parts, resulting in obstruction of the flow of oil from the tank to the burner.

6. Apparatus

6.1 *Filtration Apparatus*, constructed of brass, with copper steam coils attached, suitably supported above a vacuum flask appropriately protected against the effects of implosion. See Figs. 1 and 2.

6.2 *Temperature Measuring Device*, capable of measuring the temperature in the range from 95 to 105°C with an accuracy of 0.5°C.

6.3 *Oven*, electric, capable of maintaining a temperature of $110 \pm 1^\circ\text{C}$. The oven should be capable of safely evaporating the solvent without risk of fire.

6.4 *Stirring Rod*, glass or polytetrafluoroethylene (PTFE) approximately 150 mm in length and 3 mm in diameter.

6.5 *Beaker*, glass, 30 mL capacity, either squat form with lip or conical.

6.6 *Small Dishes*, such as watch glasses or Petri dishes.

6.7 *Hotplate*, electric.

6.8 *Steam Generator*, to provide steam at $100 \pm 1^\circ\text{C}$.

6.9 *Vacuum Source*, capable of providing the specified vacuum.

6.10 *Vacuum Gauge*, capable of measuring the specified vacuum.

*A Summary of Changes section appears at the end of this standard.

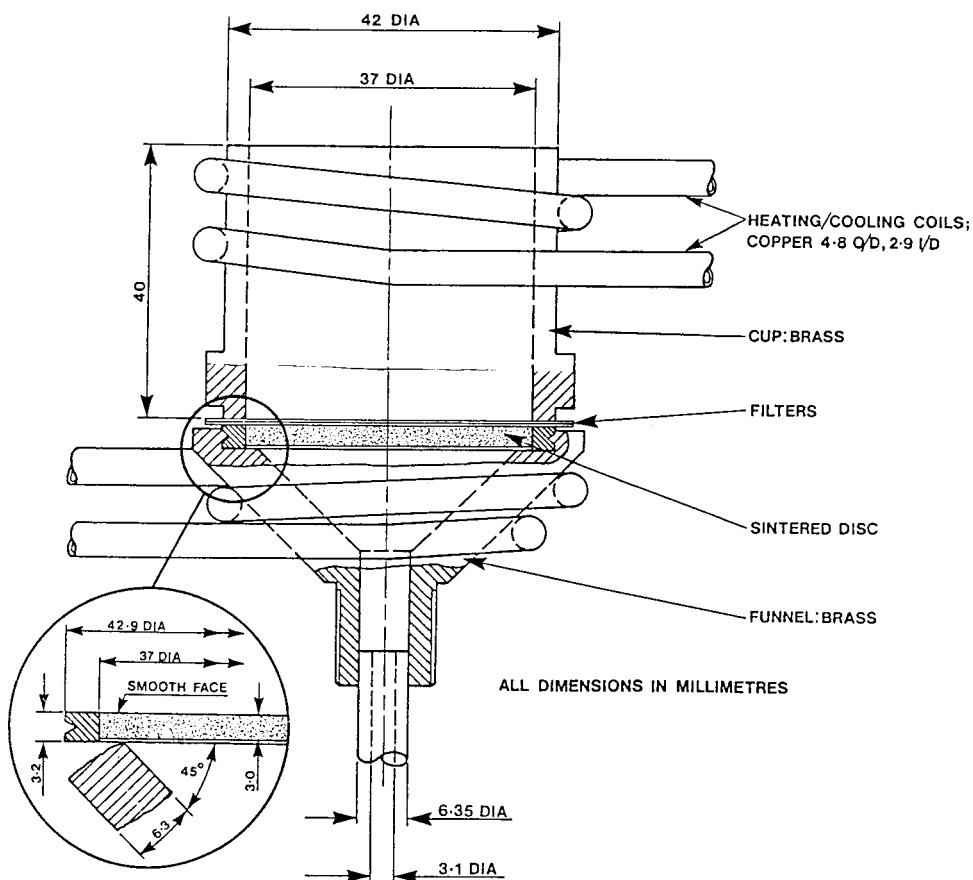


FIG. 1 Detail of Filtration Cell

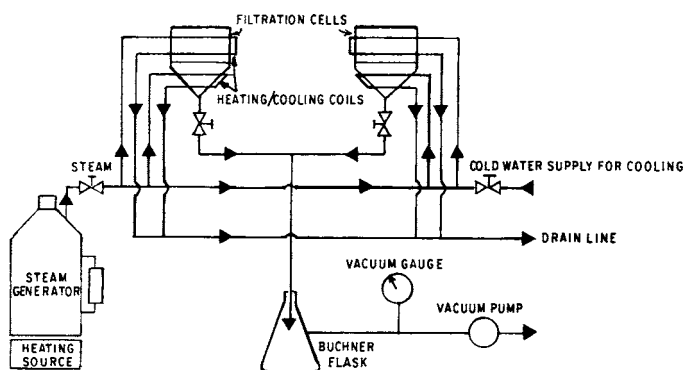


FIG. 2 Arrangement of Filtration Apparatus

6.11 *Filter Medium*, Whatman glass fiber filter medium, Grade GF/A, 47 mm diameter.

6.12 *High Speed Mixer*, any convenient type, minimum speed 400 rpm.

6.13 *Desiccator*.

6.14 *Cooling Vessel*, a desiccator or other type of tightly covered vessel for cooling the filter media before weighing. The use of a drying agent is not recommended.

6.15 *Syringe or Graduated Wash Bottle*, minimum capacity 25 mL, graduated in 0.5 mL increments.

6.16 *Forceps*, spade-ended.

7. Reagents and Materials

7.1 *Purity of Reagents*—Reagent grade chemicals shall be used in all tests. Unless otherwise indicated, it is intended that all reagents shall conform to the specifications of the committee on Analytical Reagents of the American Chemical Society, where such specifications are available.³ Other grades may be used, provided it is first ascertained that the reagent is of sufficiently high purity to permit its use without lessening the accuracy of the determination.

7.2 *Normal Heptane*, minimum 99.75 % purity. (**Warning**—Flammable, vapor harmful if inhaled. See A1.1.)

7.3 *Toluene*, at least reagent grade purity. (**Warning**—Flammable, vapor harmful. See A1.2.)

7.4 *Wash Solvent*, consisting of 85 volume % *n*-heptane (7.2) and 15 volume % toluene (see 7.3).

8. Sampling

8.1 Sample in accordance with Practice D4057 or Practice D4177.

³ *Reagent Chemicals, American Chemical Society Specifications*, American Chemical Society, Washington, DC. For Suggestions on the testing of reagents not listed by the American Chemical Society, see *Annual Standards for Laboratory Chemicals*, BDH Ltd., Poole, Dorset, U.K., and the *United States Pharmacopeia and National Formulary*, U.S. Pharmacopeial Convention, Inc. (USPC), Rockville, MD.

9. Procedure

9.1 *Sample Preparation*—Mix the whole sample, as received, thoroughly using a high speed mixer when practicable, for 30 s. In all cases a sample taken on a glass or PTFE rod dipped to the bottom of the container must show a homogeneous appearance. For fuels with a high wax content (high pour point), or of very high viscosity, the sample must be heated before stirring. The temperature must be either 15°C above the pour point in the case of low viscosity fuels, or that equivalent to 150 to 250 cSt in the case of high viscosity fuels. In no case should the temperature exceed 80°C.

9.2 *Filter Preparation*—For each test, dry two filter media for 20 min in the oven at 110°C. Transfer each filter medium, separately, rapidly to a cooling vessel and allow to cool to room temperature for 20 min. Weigh each filter medium to the nearest 0.0001 g.

NOTE 1—The Whatman GF/A filter media are fragile and are to be handled with care. Before use, check each medium for consistency, and the possible presence of small defects (holes).

NOTE 2—For convenience, place the filters on numbered small dishes (6.6) during drying and cooling.

9.3 *Apparatus Assembly*—Before use, check that the filter support screen is clean. If necessary, the screen must be cleaned by boiling in a high boiling point aromatic solvent. When more than 2 % of the sinter area remains blocked by particulate matter after such cleaning, discard the screen and install a new one.

9.3.1 The filtration unit must be clean and dry before assembly. Stack the two previously dried and weighed filter media on top of the sinter support with the mesh imprint side down, using forceps. Apply slight vacuum to aid in centering the filter media, and place the top portion of the filtration apparatus carefully on to the media before clamping. Shut off the vacuum and pass steam at 100 ± 1°C through the heating/cooling coils for 10 min prior to sample addition.

9.4 *Sample Addition*—Into a 30 mL beaker, pour approximately 11 g of the fuel sample prepared as described in 9.1 and weigh to the nearest 0.01 g. Connect the vacuum source and apply vacuum to an absolute pressure of 40 ± 2 kPa minimum (61.3 kPa vacuum). Heat the contents of the beaker to 100 ± 2°C. Then transfer the contents at 100 ± 2°C (Note 3) to the center of the filter medium, taking care that no sample touches the walls during transfer (Note 4). Reweigh the beaker to the nearest 0.01 g. The quantity transferred should be 10 ± 0.5 g. When filtration is not complete in 25 min, discontinue the test and repeat using 5 ± 0.3 g of sample. If filtration is still not complete in 25 min, report the result as *filtration exceeds 25 min*.

NOTE 3—It is expedient to weigh the beaker plus stirrer plus temperature measurement device before and after transfer to avoid errors incurred by attempting to obtain a net weight. Any convenient means of heating the fuel sample to 100 ± 2°C may be used, such as hot plate, water or oil bath, or an oven when equipped with a suitable stirrer. Samples that overheat above 105°C must be discarded and not reused.

NOTE 4—For samples of high viscosity or high sediment, level filtration will be aided by small stage or even dropwise addition. It is preferable to avoid complete coverage of the filter medium with unfiltered oil sample. For samples of low filtration rate the pressure of 40 ± 2 kPa should be maintained for the 25-min period.

9.5 *Filter Washing*—When the filtration is complete and the upper filter medium appears dry, continue the steam and vacuum for a further 5 min. Discontinue the steam supply and cool the apparatus by passing tap water through the coils. Wash the filtration unit carefully with two portions of 25 ± 1 mL of the wash solvent from a syringe or graduated wash bottle with a fine nozzle, taking care to remove any adhered sample from the wall of the upper part of the apparatus. Carefully remove the top portion of the filtration unit and wash the rim of the filter with a further 10 ± 0.5 mL of the wash solvent in a similar manner. Finally wash the whole of the filter medium area with 10 ± 0.5 mL of *n*-heptane.

NOTE 5—If the sample filters very rapidly, the vacuum should be released before the first solvent washing, to ensure complete coverage of the filter medium area by solvent. The vacuum should then be gently reapplied for the subsequent operations.

9.6 *Apparatus Disassembly*—After the filter medium appears dry, discontinue the vacuum supply. Using the forceps, carefully remove each filter medium separately and transfer them to the oven at 110°C. Dry for 20 min and quickly transfer them to the cooling vessel (6.14). Allow them to cool to room temperature for 20 min and reweigh them to the nearest 0.0001 g.

10. Calculation

10.1 Calculate the mass percentage of total sediment for each test specimen using Eq 1. For each test specimen with a calculated total sediment concentration >0.005 % m/m as determined by Eq 1, record the mass percentage of total sediment to the nearest 0.01 % m/m. For each test specimen with a total sediment concentration ≤0.005 % m/m, record the result as 0.00 % m/m.

$$S = \frac{(M_5 - M_4) - (M_3 - M_2)}{10 M_1} \quad (1)$$

where:

S = total sediment, % m/m,

M_1 = mass of sample, g,

M_2 = mass of lower filter medium before filtration, mg,

M_3 = mass of lower filter medium after filtration, mg,

M_4 = mass of upper filter medium before filtration, mg, and

M_5 = mass of upper filter medium after filtration, mg.

11. Report

11.1 Report the total sediment by hot filtration as the average of duplicate determinations, to the nearest 0.01 % m/m. If the average of the duplicate determinations is <0.01 % m/m, report it as “<0.01 % m/m.” If a 5-g sample has been used, report the results as total sediment (5 g) by hot filtration. If filtration is not complete within the specified 25 min, report the results as *filtration time exceeds 25 min*.

11.2 *Test Report*—The test report shall contain at least the following information:

11.2.1 The type and identification of the product tested,

11.2.2 A reference to this test method,

11.2.3 The result of the test (see 11.1),

11.2.4 Any deviation, by agreement or otherwise, from the standard procedures specified (see 11.1), and

11.2.5 The date of the test.

12. Precision and Bias⁴

12.1 *Precision*—The precision of this test method as determined by the statistical examination of interlaboratory test results is as follows. The results ranged from 0.01 to 0.40 % m/m for distillate fuel oils containing residual components and from 0.01 to 0.50 % m/m for residual fuel oils.

12.1.1 *Repeatability*—The difference between successive test results, expressed as the average of duplicate determinations, obtained by the same operator with the same apparatus under constant operating conditions on identical test material, would, in the long run, in the normal and correct operation of the test method, exceed the following values only in one case in twenty:

$$r = 0.089 \sqrt{x} \text{ for residual fuels, and} \quad (2)$$

$$r = 0.048 \sqrt{x} \text{ for distillate fuels containing residual components} \quad (3)$$

⁴ Supporting data have been filed at ASTM International Headquarters and may be obtained by requesting Research Report D02-1238.

where x = the average of the test results, % m/m.

12.1.2 *Reproducibility*—The difference between two test results, expressed as the average of duplicate determinations independently obtained by different operators operating in different laboratories on nominally identical test material would, in the long run, in the normal and correct operation of the test method, exceed the following values only one case in twenty:

$$R = 0.294 \sqrt{x} \text{ for residual fuels, and} \quad (4)$$

$$R = 0.174 \sqrt{x} \text{ for distillate fuels containing residual components} \quad (5)$$

where x = the average of the test results, % m/m.

12.2 *Bias*—Since there is no accepted reference material suitable for determining the bias for the procedure in this test method, bias cannot be determined.

13. Keywords

13.1 ageing; fuel oils; hot filtration; residual fuel; sediment; storage stability; total sediment

ANNEX

(Mandatory Information)

A1. HAZARD STATEMENTS

A1.1 *n*-Heptane

Keep away from heat, sparks, and open flame.
Keep container closed.
Use with adequate ventilation.
Avoid prolonged breathing of vapor or spray mist.
Avoid prolonged or repeated skin contact.

A1.2 Toluene

Keep away from heat, sparks, and open flame.
Keep container closed.
Use with adequate ventilation.
Avoid breathing of vapor or spray mist.
Avoid prolonged or repeated skin contact.

APPENDIX

(Nonmandatory Information)

X1. PREDICTION OF TOTAL SEDIMENT IN RESIDUAL FUEL OILS (STANDARD PROCEDURES FOR AGEING)

X1.1 Scope

X1.1.1 This test method describes two procedures for evaluating the sediment forming tendency of residual fuel oils during storage.

NOTE X1.1—Experience has shown that this test method can be applicable to other fuel oils as well, but precision is unknown and additional testing is required to determine that precision.

X1.1.2 Procedure A covers thermal ageing.

X1.1.3 Procedure B covers chemical ageing.

X1.2 Terminology

X1.2.1 *Definitions of Terms Specific to This Standard:*

X1.2.1.1 *accelerated total sediment*—the total sediment formed in a fuel when it is diluted with hexadecane and stressed at an elevated temperature.

X1.2.1.2 *potential total sediment*—the total sediment formed by stressing a fuel at an elevated temperature.

X1.3 Summary of Test Method

X1.3.1 *Procedure A for Thermal Ageing*—A sample of residual fuel oil is aged at 100°C for 24 h.

X1.3.2 *Procedure B for Chemical Ageing*—A sample of residual fuel oil is diluted with hexadecane (cetane) and then heated to 100°C for 1 h.

X1.3.3 Following ageing by the above procedures, the sample is then filtered at 100°C, solvent washed and dried, and the total sediment on the filter medium weighed, in accordance with Test Method D4870. The test is to be carried out in duplicate.

X1.4 Significance and Use

X1.4.1 The precipitation of asphaltenes from a residual fuel oil during storage and handling can cause severe difficulties which, in extreme cases, can render the fuel unfit for use. Once out of solution, it is extremely difficult to reprecipitate the asphaltenes into their original state.

X1.4.2 The procedures described in this test method are useful for determining whether sediment is likely to precipitate from a residual fuel oil during storage.

X1.4.3 Thermal ageing is a well established technique for determining whether sediment will precipitate from residual fuel oils during storage and handling.

X1.4.4 Chemical ageing looks at the balance between the required aromaticity of the asphaltenes and the available aromaticity of the oil phase, and tests whether a specified amount of a normal alkane disturbs this balance to the extent that asphaltene precipitation occurs. Experience has shown that such precipitation indicates that sediment can form in the residual fuel oil during storage and handling.

X1.5 Apparatus

X1.5.1 *Oil Bath*, a constant temperature bath capable of being maintained at a temperature of $100 \pm 0.5^\circ\text{C}$, and large enough to hold two or more air wells through cover openings, and with an additional opening in the cover through which the oil bath temperature measuring device can be suspended.

X1.5.2 *Air Well*, cylinder 55 mm in inside diameter and 120 mm in length, provided with a cover having a central opening approximately 10 mm in diameter for supporting the condenser tube in a vertical position.

NOTE X1.2—The air well and oil bath can be made in one assembly as shown in Fig. X1.1.

X1.5.3 *Oil Bath Temperature Measuring Device*, capable of measuring the temperature in the range from 95 to 103°C with an accuracy of 0.5°C.

NOTE X1.3—A Type 22C thermometer in Specification E1 has been found suitable for use.

X1.5.4 *General Purpose Temperature Measuring Device*, capable of measuring the temperature in the range from 0 to 100°C with an accuracy of 0.5°C.

NOTE X1.4—A Type 1C thermometer in Specification E1 has been found suitable for use.

X1.5.5 *Glassware*, is used to contain the test sample, deliver solvent into the flask, and collect and return condensable volatiles.

X1.5.5.1 *Conical Flask*, 50 mL capacity Erlenmeyer flask with narrow mouth.

X1.5.5.2 *Condenser*, air, of borosilicate glass tubing, 8 mm in outside diameter, wall thickness 1.0 mm, and 400 mm in length.

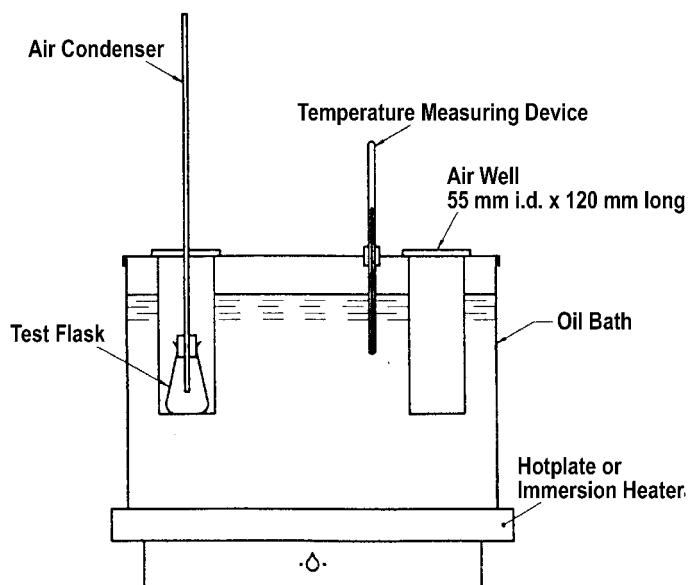


FIG. X1.1 Ageing Bath

X1.5.5.3 *Microburette*, minimum capacity 5 mL, with a maximum graduation interval of 0.02 mL.

X1.5.5.4 *Funnel*, of borosilicate glass, capacity 5 to 10 mL, with an outlet orifice 0.4 ± 0.02 mm in diameter.

X1.5.6 *Stoppers*, size No. 1.

X1.5.6.1 *Cork*, bored centrally for the air condenser.

X1.5.6.2 *Rubber*, unbored.

X1.5.7 *Stirring Rod*, glass or polytetrafluoroethylene (PTFE) approximately 150 mm in length and 3 mm in diameter.

X1.5.8 *Magnetic Stirrer/Hotplate*, thermostatically controlled.

X1.5.9 *Surface Temperature Measuring Device*, capable of measuring the temperature up to 200°C.

X1.5.10 *Stirring Bar*, magnetic, PTFE-coated, 25 mm in length.

X1.5.11 *Spatula*, polypropylene, beveled ends, 200 mm in length.

X1.5.12 *Warm Air Dryer*, handheld, electric.

X1.5.13 *Stirrer*, any convenient type, minimum speed 400 rpm.

X1.6 Reagents

X1.6.1 *Hexadecane (cetane)*—Commercial-grade normal hexadecane of 99 % purity, minimum. (**Warning**—Hexadecane is a mild eye and mucous membrane irritant, primarily a skin irritant, and central nervous system depressant.)

NOTE X1.5—Hexadecane should be stored at or above 20°C, or brought to a minimum of this temperature before use. When stored at a temperature below 20°C, a handheld warm air dryer can be used for warming the bulk hexadecane when it is needed for use.

X1.7 Sampling

X1.7.1 The sample aliquot for these procedures shall be taken, in accordance with Practice D4057, from the same

container as that taken for Test Method D4870. It will be normally taken at the same time, and thus follow the same sample preparation.

X1.7.2 Sample Preparation—The whole sample, as received, shall be thoroughly mixed using a stirrer when practicable for 30 s. In all cases, a sample taken on a glass or PTFE rod dipped to the bottom of the container must show a homogeneous appearance. For fuels with a high wax content (high pour point), or of very high viscosity, the sample must be heated before stirring. The temperature, as measured with the general purpose temperature measuring device, must be either 15°C above the pour point in the case of low viscosity fuels, or that equivalent to 150 to 250 cSt in the case of high viscosity fuels. In no case shall the temperature exceed 80°C.

X1.8 Procedure A for Thermal Ageing

X1.8.1 Pour duplicate 25 ± 1 g aliquots of the thoroughly mixed sample into each of two conical flasks, attach the air condenser by means of the cork stopper, and place the flasks in the air wells of the oil bath, maintained at $100 \pm 0.5^\circ\text{C}$, for $24 \text{ h} \pm 15 \text{ min}$.

X1.8.2 Remove the flask from the bath, replace the air condenser and cork stopper by the rubber stopper and shake vigorously until all the sludge has been uniformly suspended. Invert the flask and examine its bottom and wall for any sludge deposits. Remove stubborn deposits from the wall or bottom of the conical flask by scraping with the spatula. Shake again vigorously and initiate hot filtration in accordance with Test Method D4870 within 1 min.

X1.9 Procedure B for Chemical Ageing

X1.9.1 Preheat the magnetic stirrer/hotplate to a surface temperature corresponding to the temperature at which the sample under investigation will have a kinematic viscosity of approximately 50 cSt. Avoid (local) overheating of the sample when placed on the stirrer/hotplate. Overheating can cause sample decomposition processes. Measure the temperature of the stirrer/hotplate by a surface temperature measuring device.

X1.9.2 Weigh duplicate 25 ± 0.2 g aliquots of the thoroughly mixed sample into each of two conical flasks and add a PTFE-coated magnetic stirring bar. Place the flask in the center of the preheated magnetic stirrer/hotplate and adjust the stirring speed to approximately 200 rev/min. After 10 min, slowly add 2.5 ± 0.02 mL of hexadecane from the microburette to the flask at a maximum rate of 1.0 mL/min while continuously stirring.

NOTE X1.6—To prevent possible freezing of the hexadecane at test temperatures near 18°C, the microburette should be warmed slightly. The handheld warm air dryer is suitable for this purpose.

NOTE X1.7—Avoid localized over-dilution during the addition step to

preclude flocculation of asphaltenes. Asphaltenes which are flocculated during the addition of hexadecane owing to lack of homogeneity are not easily reprecipitated afterwards, and can produce anomalous results.

X1.9.3 The maximum rate of addition can be controlled by positioning the microburette above a funnel (**X1.5.5.4**) and discharging the 2.5 ± 0.02 mL directly into the funnel neck, and allowing the hexadecane to drip into the stirred sample by gravity. Direct addition of the hexadecane from the microburette is not recommended, but if carried out it is essential that the orifice diameter of the microburette should not exceed 1.0 mm and the overall tip diameter should not exceed 5.0 mm.

X1.9.4 The rate of addition can be calibrated by plotting mass transferred (hexadecane density at 20°C = 0.7733 g/mL) against volume measured from the microburette, and time of delivery.

X1.9.5 Pour the sample/hexadecane mixture into a clean 50 mL conical flask and attach the air condenser by means of the cork stopper. Place the flask in the air well of the oil bath at $100 \pm 0.5^\circ\text{C}$. Allow the flask to remain in the bath for $60 \pm 2 \text{ min}$.

X1.9.6 Remove the flask from the bath, replace the air condenser and cork stopper by the rubber stopper and shake vigorously until all the sludge has been uniformly suspended. Invert the flask and examine its bottom and wall for any sludge deposits. Remove stubborn deposits from the wall or bottom of the flask by scraping with the spatula. Shake again vigorously and initiate hot filtration in accordance with Test Method D4870 within 1 min.

X1.10 Report

X1.10.1 Report the following information:

X1.10.1.1 Report the potential total sediment (Procedure A) as the average of duplicate determinations, to the nearest 0.01 % m/m.

X1.10.1.2 Report the accelerated total sediment (Procedure B) as the average of duplicate determinations, to the nearest 0.01 % m/m.

NOTE X1.8—When calculating the results of determinations of accelerated total sediment, account shall be taken of the hexadecane diluent. The divisor in the formula in Test Method D4870 becomes $9.28 M_1$ rather than the $10 M_1$ given.

X1.10.1.3 The results obtained from samples aged according to the procedures in **X1.8** and **X1.9** give a prediction of total sediment. To obtain a prediction of sediment formation during storage, compare results from the aged samples to results obtained on an aliquot of the same sample in an unaged condition (existent total sediment), determined in accordance with Test Method D4870. Such a comparison provides an indication of whether sediment is likely to precipitate from the fuel oil during storage.

SUMMARY OF CHANGES

Subcommittee D02.14 has identified the location of selected changes to this standard since the last issue (D4870–07a) that may impact the use of this standard. (Approved April 15, 2009.)

(1) Revised **6.6, 9.2, Note 2, 9.3.1, 9.6, and 10.1.**

Subcommittee D02.14 has identified the location of selected changes to this standard since the last issue (D4870–07) that may impact the use of this standard. (Approved July 1, 2007.)

(1) Revised **9.2, 9.6, and 10.1.**

Subcommittee D02.14 has identified the location of selected changes to this standard since the last issue (D4870–04) that may impact the use of this standard. (Approved Feb. 1, 2007.)

(1) Revised **6.2, 9.2, 10.1, 11.1, X1.5.1, X1.5.3, X1.5.4, X1.5.9, X1.7.2, and X1.9.1.** (2) Revised **Fig. X1.1.**

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).